

RECLAMATION

Managing Water in the West

Lower Colorado Dam's Quagga Mussel Assessment and Potential Control/Preventive Program

Leonard Willett, BOR - Hoover Dam Water Treatment Group Manager



U.S. Department of the Interior
Bureau of Reclamation

Agenda

- **BACKGROUND**
- **BUREAU OF RECLAMATION LOWER COLORADO DAMS (LCD) CONTRACTED WITH QUAGGA MUSSEL CONSULTANT – RENATA CLAUDI (RNT CONSULTING)**
- **LESSONS-LEARNED FROM ONTARIO POWER PLANTS**
- **COMPREHENSIVE FACILITY REVIEW OF THE DAMS**
- **FINDINGS & POTENTIAL CONTROL/PREVENTIVE MEASURES**

RECLAMATION

Consultant and LCD Quagga Mussel Point of Contact

- Contracted with RNT Consulting Inc.
Ms. Renata Claudi, Chief Scientist
823 County Road 35 - Picton, Ontario, Canada K0K 2T0
Phone/Fax (613) 476-7994 - E-mail: rnt@idirect.com
- Bureau of Reclamation – Hoover Dam Engineering
Mr. Leonard Willett, Water Treatment Manager
Boulder City, NV 89006 – Phone (702) 494-2216
E-mail: lwillett@lc.usbr.gov

RECLAMATION


Site Visit Experience Ontario Hydro Power Facilities (reactive approach)



Sir Adam Beck #2



Sir Adam Beck #1

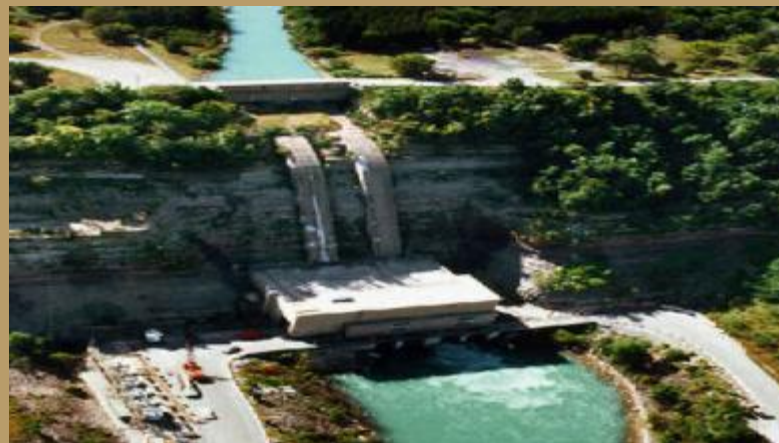

DeCew #2



Pump Generating Station

RECLAMATION

Nanticoke Coal Fired Facility Ontario (proactive approach)



RECLAMATION

Over time if left untreated

- Transformer cooling water piping plugged at Ontario Hydro Power



Water Cooled
Transformer Piping

RECLAMATION

Ontario Hydro Plant Unit Coolers



Dead Mussels Found in Unit Coolers

RECLAMATION

Quagga Mussel Infestation at Dams; What have we learned and what do we recommend

RNT Consulting Inc.

RECLAMATION




Observations from inspection of external surfaces

- Mussels are present in the lower penstock (Living 200 + psi pressure)



RECLAMATION

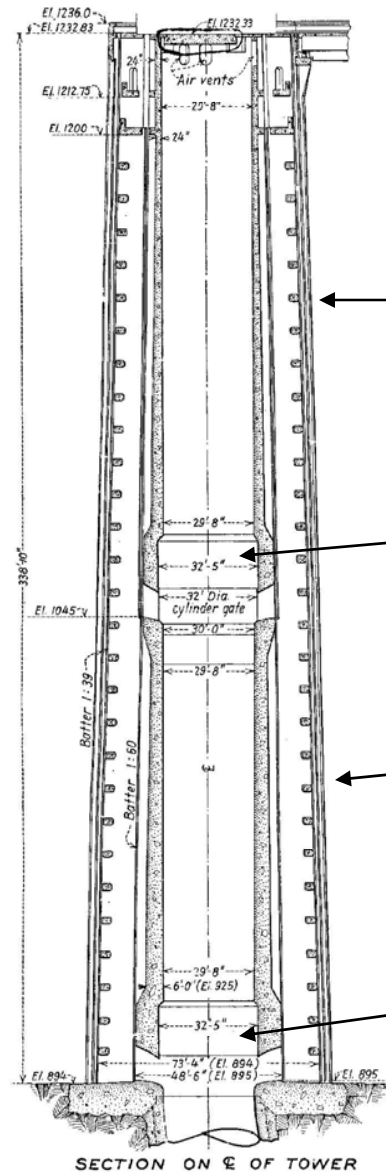

Elev 1111
Dec 2007 Lake
Mead Level

Elev 1045
66'

Elev 970
141'

Elev 894
217'

Sampling Plates at Parker Dam November 7/07



RECLAMATION



RECLAMATION

Davis Dam Penstock Gate Oct.07



RECLAMATION

Proactive vs. Reactive Control Measures

- Proactive

Does not allow growth of mussels in the system or on the surface protected

- Reactive

Does allow mussels to grow in the system or on the surface. Established populations have to be eliminated periodically

Findings & Potential Control Measures

- All three dams use the same settlement substrate on the sampling plates
- Same dimensions
- At the same depth (10ft, 20....down to maximum depth)
- Examine the plates at the same time interval and in the same manner
- Multiple strings of sampling plates lakeside and in the tailbay




**CONTINUE
MONITORING USING
SETTLING PLATES**



RECLAMATION

Install Side stream sampler
for plant monitoring

Bio-box

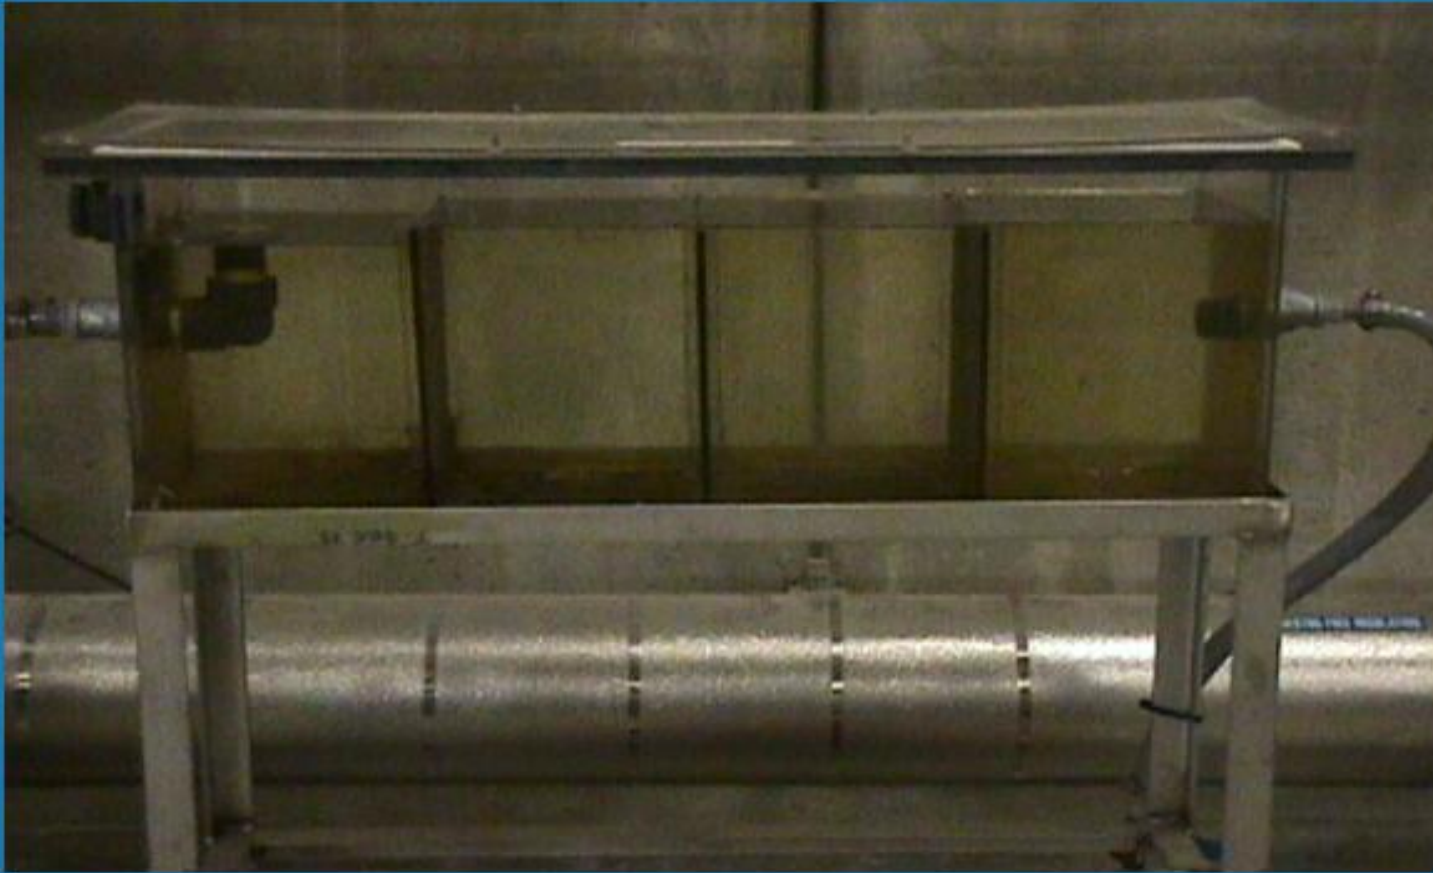

RECLAMATION



RECLAMATION

Options for External Structures*

***Structures That Are in Direct Contact With
the External Environment; No Isolation Is
Possible**

RECLAMATION

Reactive Options for External Structures

Mechanical Cleaning



- de-water and use powerwash
- underwater, scrape and vacuum or powerwash

RECLAMATION

Proactive Options for External Structures

- Antifouling Coatings - for both steel and concrete
- Non-toxic, silicone based
- Toxic, copper based coatings
- Life-span 5-7 years before topcoat needs to be refreshed

Reactive Options for Internal Piping Systems

- **Thermal Wash** - 32°C for 48 hours (90° F)
40°C for 1 hour (104° F)
- **Mechanical Cleaning** such as
 - scrape large diameter pipes
 - use remote vehicle tools on difficult areas
- **Flushing with weak acids**
- **Oxygen Deprivation**

Reactive Options for Internal Piping Systems

- **Periodic (once or twice/year) application of**
 - **Non-oxidizing chemicals**
 - **Oxidizing chemical**

Oxidizing Chemical Treatment

- Chlorine
- Bromine
- Chlorine dioxide
- Chloramines
- Ozone
- Potassium permanganate



RECLAMATION

Emerging Options

- Bacterial product, zebra mussel specific chemical....being tested on Quagga now
- Bio-Bullets

Proactive Options for Internal Piping Systems

- Sand/media filtration - has to remove all particles greater than 40 micron
- Mechanical filtration - has to remove all particles greater than 40 micron

Example of 40 micron self cleaning filters


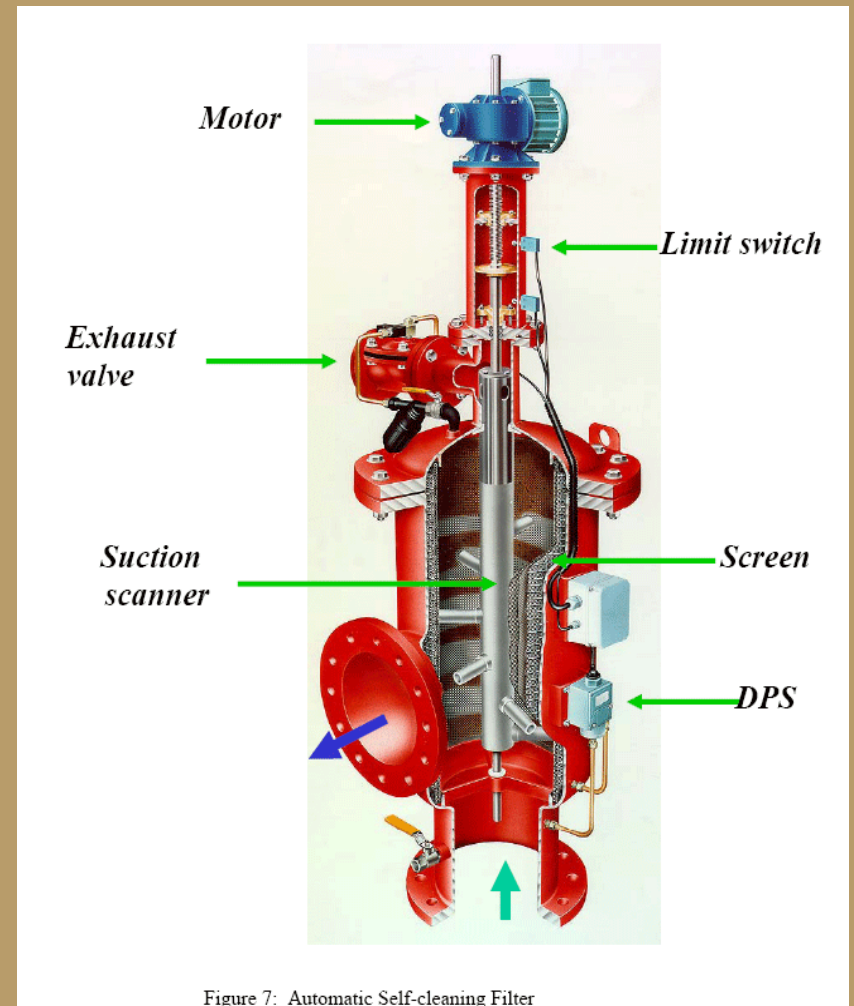


Figure 7: Automatic Self-cleaning Filter

RECLAMATION

40 MICRON SELF CLEANING FILTER

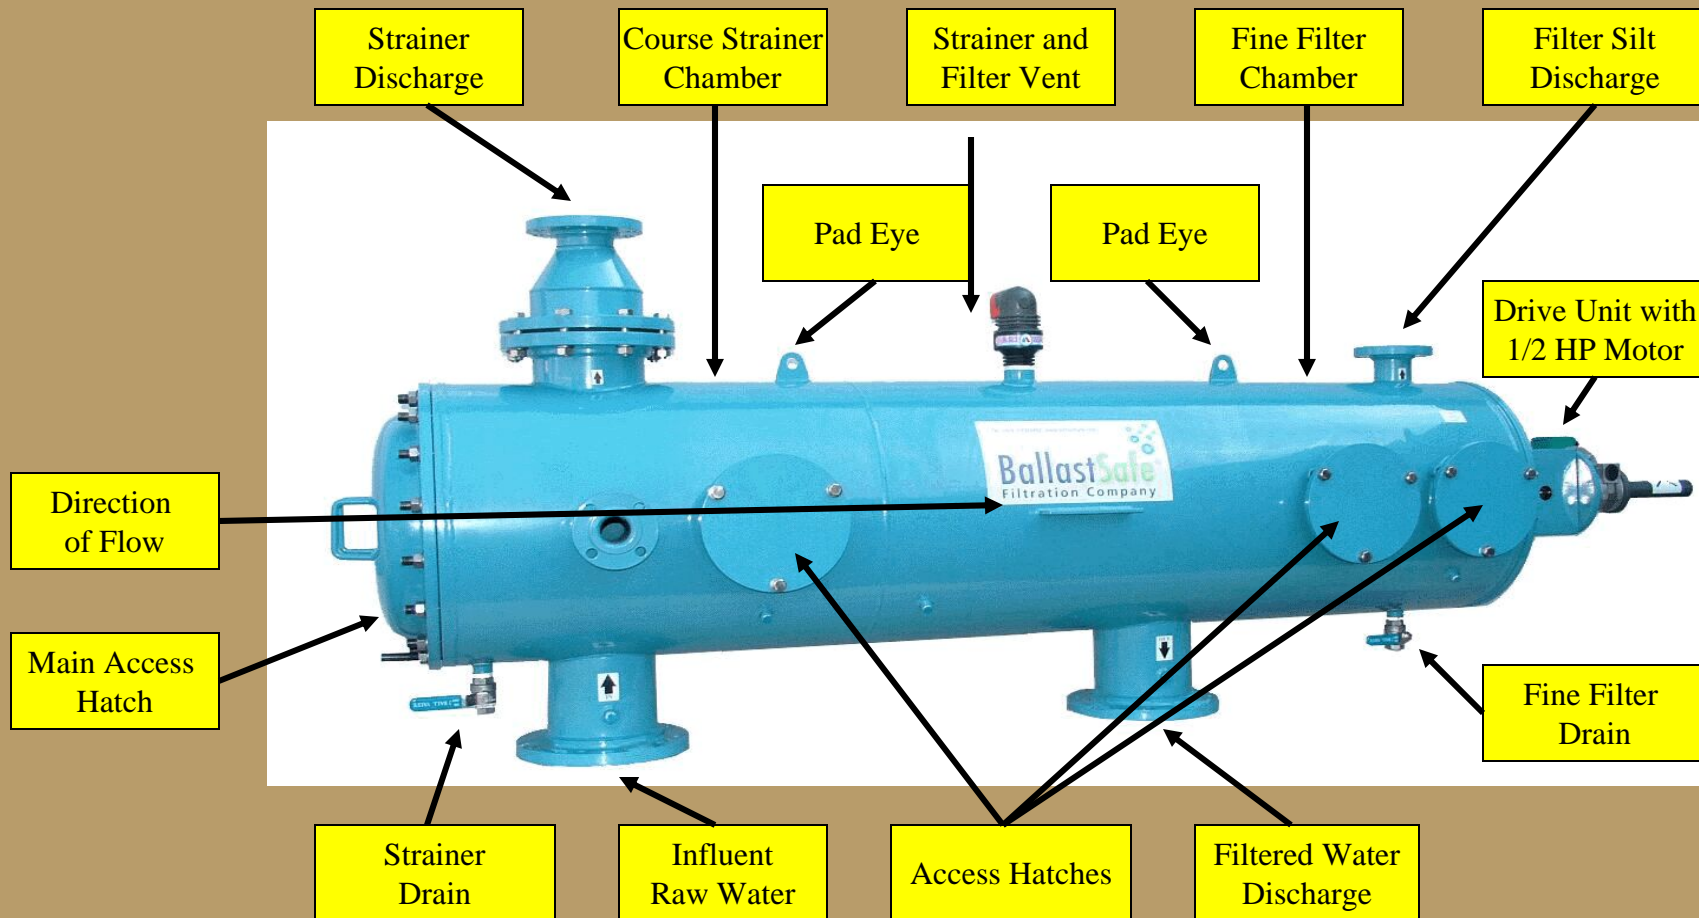


RECLAMATION

Additional Proactive Options for Internal Piping Systems


- UV systems
- Closed Loop Cooling
- Oxidizing chemicals
- Non-Oxidizing chemicals

In Line Pipeline UV Installation

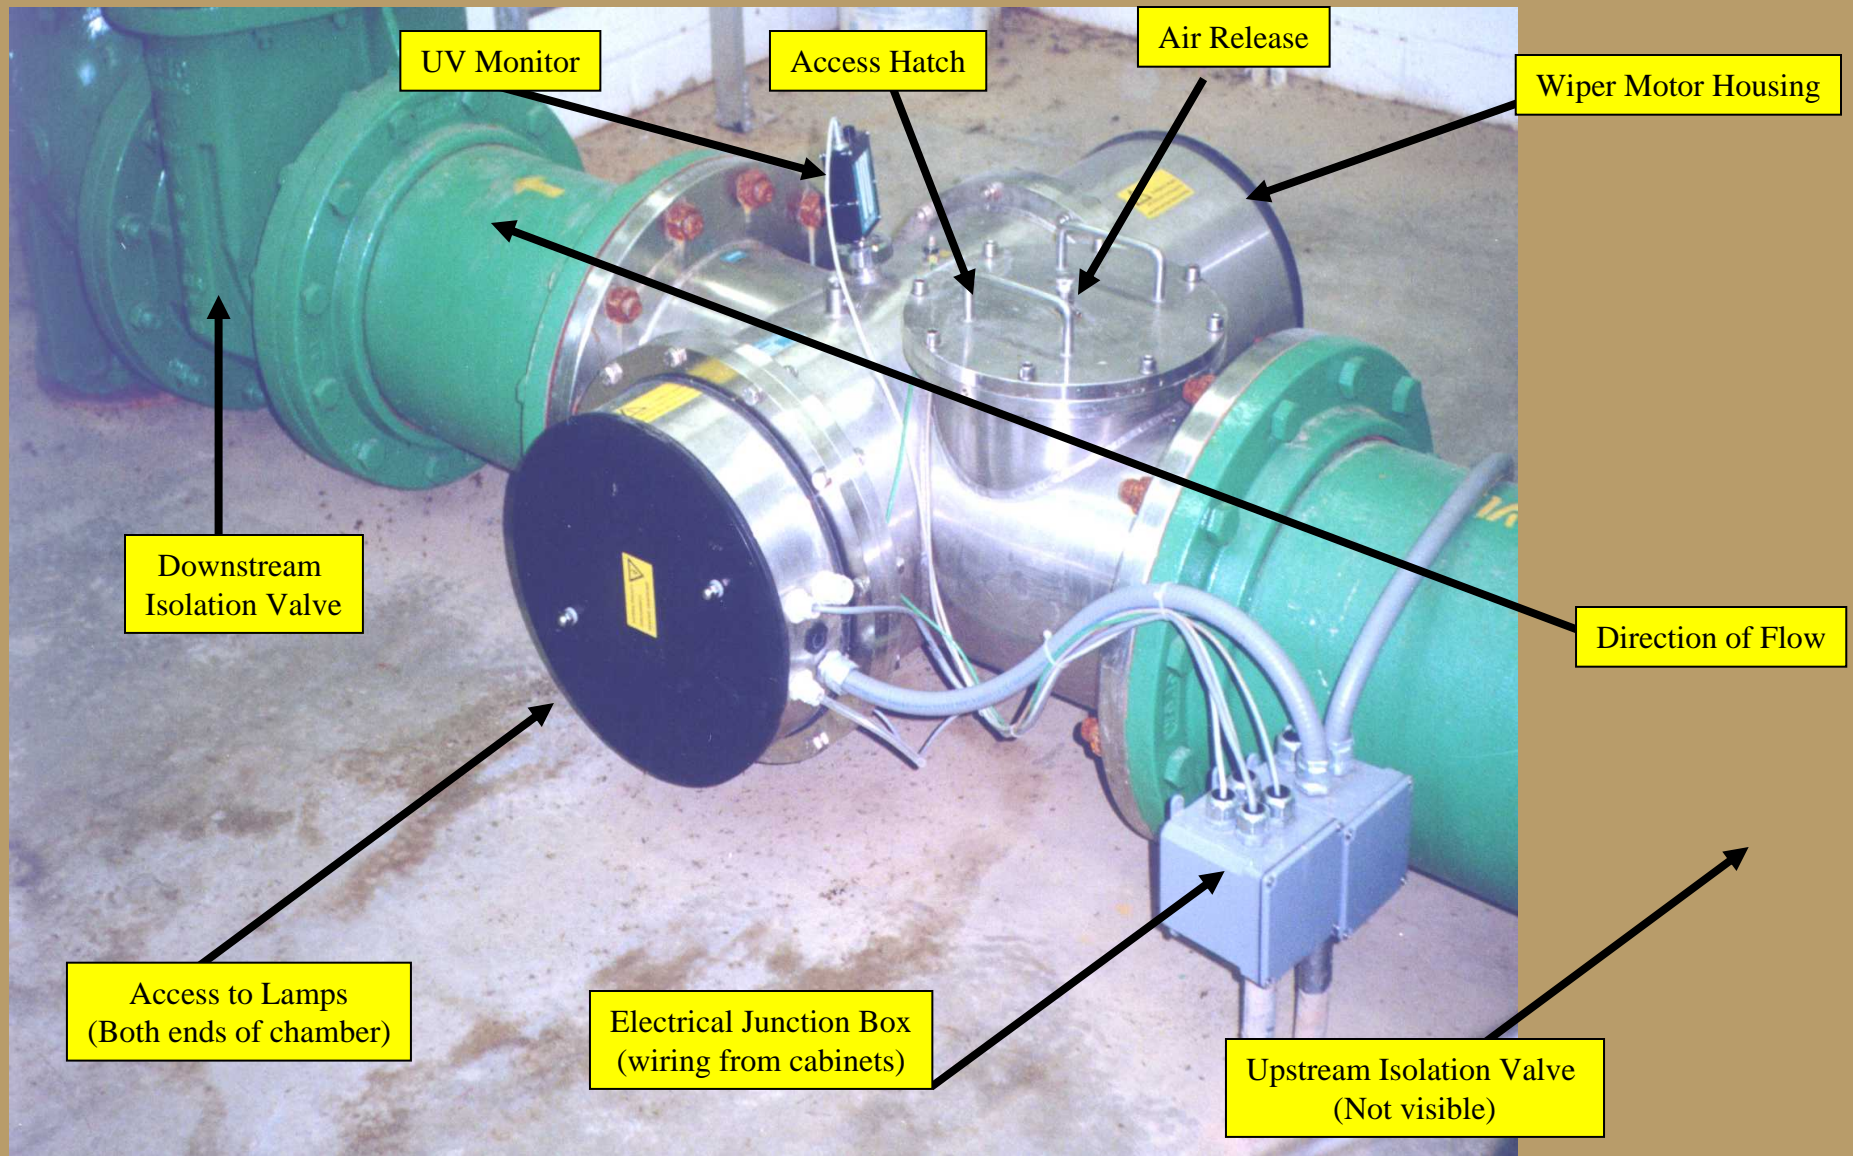

RECLAMATION

UV Light Bank for Open Channel

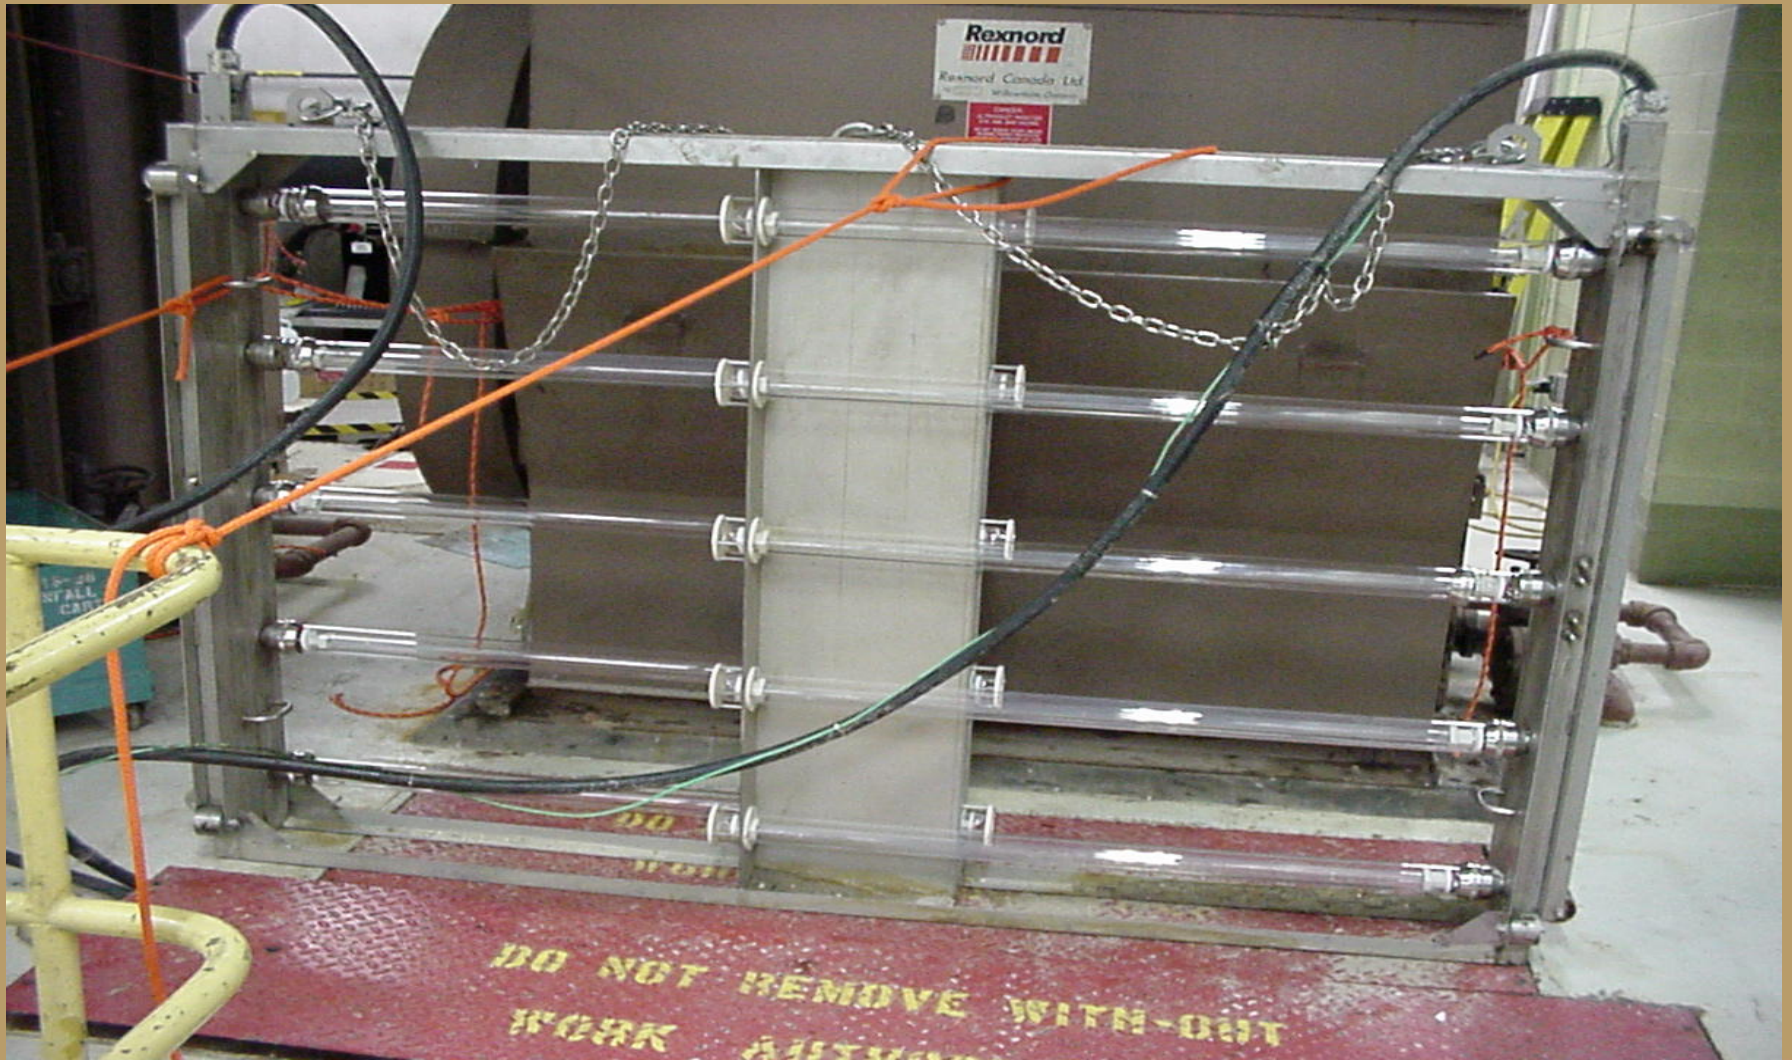

RECLAMATION

RECLAMATION

Managing Water in the West

QUESTIONS

**Leonard Willett, - Hoover Dam Water Treatment Group Manager
(702) 494-2216 or E-Mail: LWillett@lc.usbr.gov**



U.S. Department of the Interior
Bureau of Reclamation